


Best Water! Best Service!



GARDNERVILLE WATER COMPANY - COMBINATION AIR VALVE ASSEMBLY (G-11)

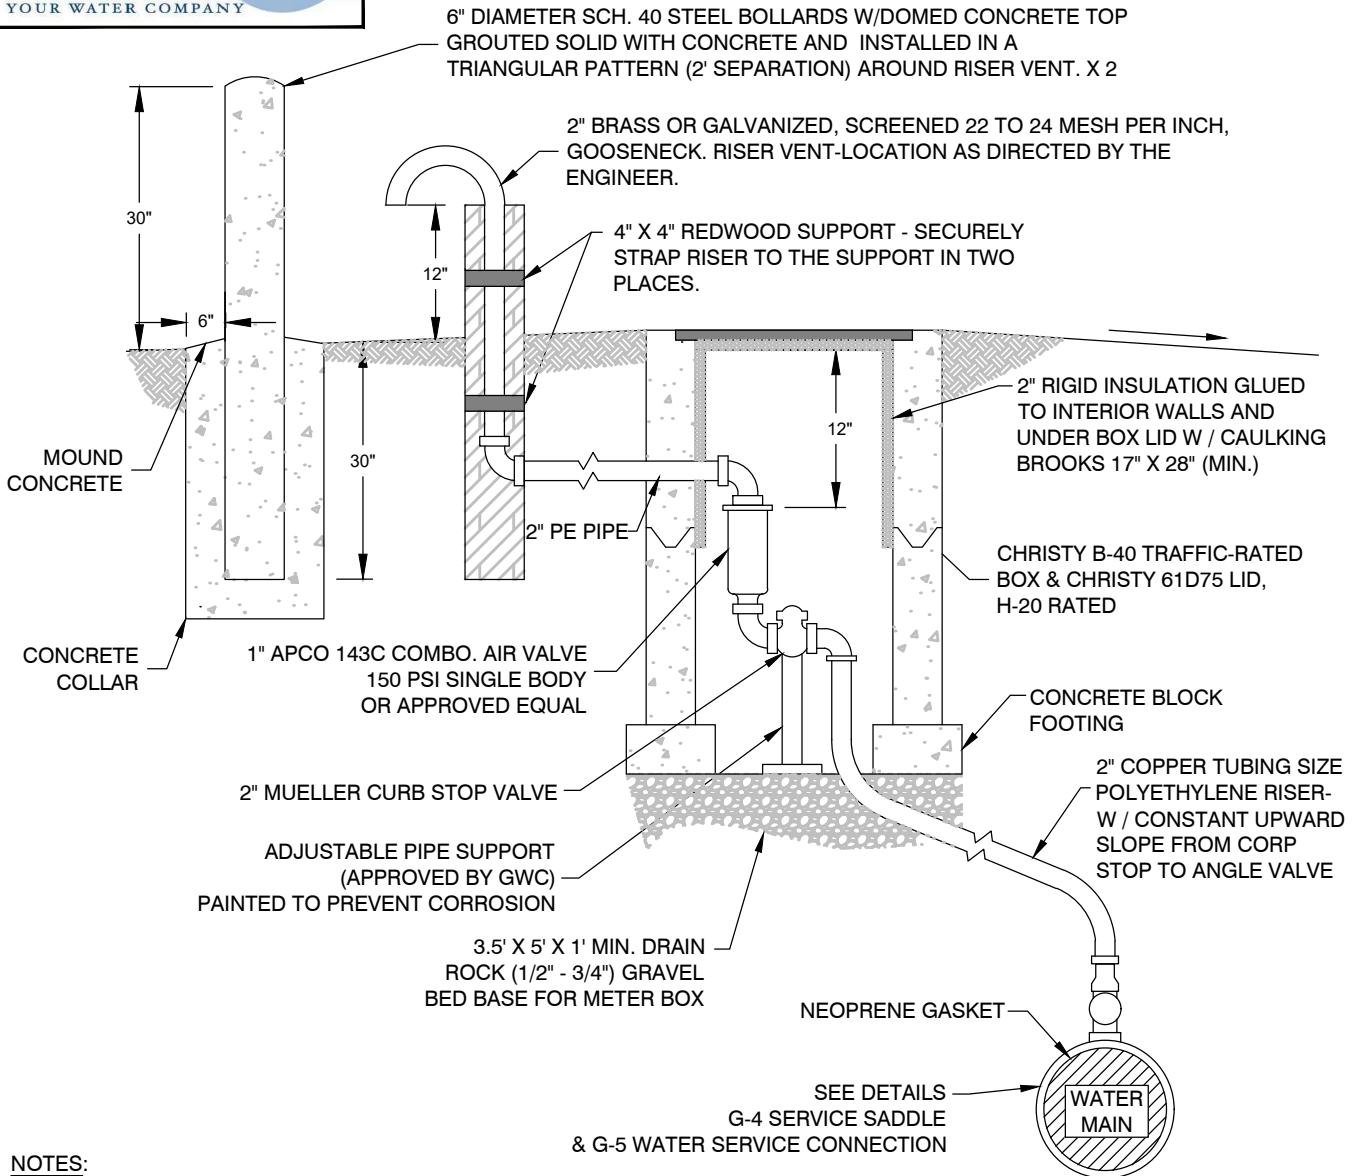

NOTES:

1. AIR RELEASE VALVES SHALL BE BETWEEN 2-4 FEET BEHIND SIDEWALK.
2. COORDINATE WITH GARDNERVILLE WATER COMPANY FOR ASSEMBLY LOCATION TO ALLOW FOR REMOVAL AND REPAIR.
3. ALL PIPES SHALL BE SLOPED UP TO AIR RELEASE VALVE. FINISHED GRADE SHALL SLOPE AWAY FROM THE BOX IN ALL DIRECTIONS.
4. ALL VALVES SHALL BE BRONZE OR BRASS. ALL PIPES AND FITTINGS SHALL BE BRASS EXCLUDING VENT PIPES.
5. STEEL PIPE PAINT SHALL BE RUST-OLEUM 7400 HIGH GLOSS SAFETY YELLOW ALKYD ENAMEL OR GARDNERVILLE WATER COMPANY APPROVED EQUAL.

NO.	REVISION	DATE	GARDNERVILLE WATER COMPANY - STANDARD DETAIL	DRAWING NO.	
			<h1>COMBINATION AIR VALVE ASSEMBLY</h1>	<h2>G-11</h2>	
				DATE:	PAGE:
				09/22	11