


Best Water! Best Service!



GARDNERVILLE WATER COMPANY - WATER SERVICE CONNECTION (G-5)

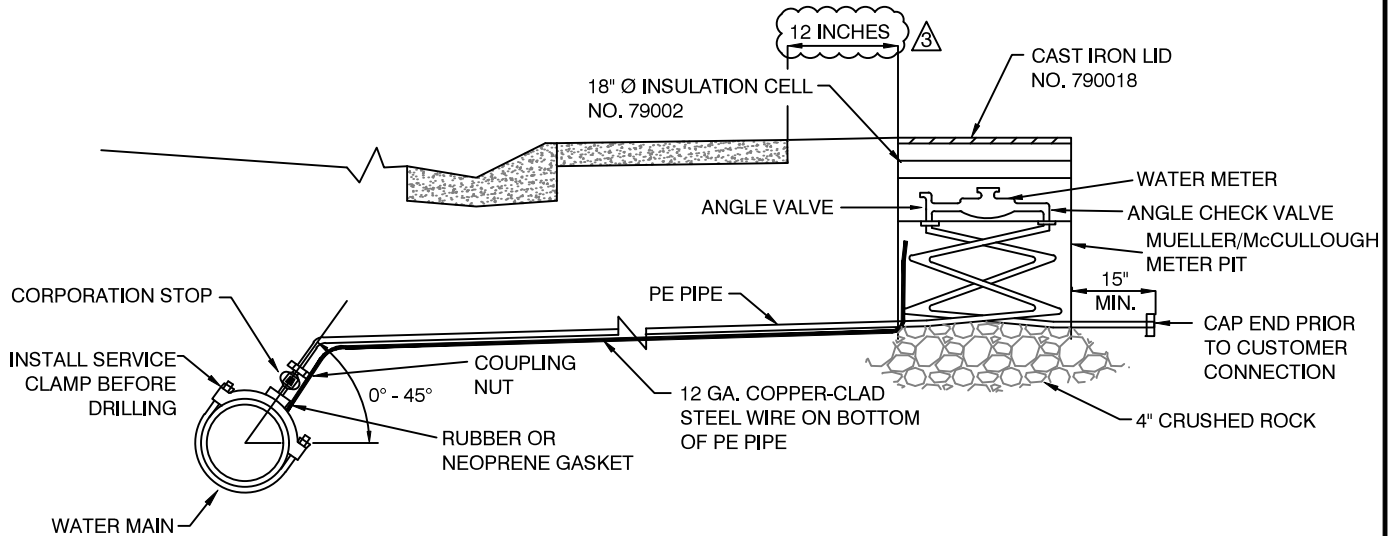

NOTES:

1. CORPORATION STOP, CURB STOP, AND SERVICE LINE SHALL BE THE SAME SIZE.
2. COMPRESSION FITTINGS SHALL BE USED AT ALL CONNECTIONS .
3. SERVICE CLAMPS SHALL BE DOUBLE STRAP 1" TO 2" SERVICES.
4. NO EXTENSIONS ARE ALLOWED ON METER PIT.
5. TOP OF METER PIT SHALL BE SET AT 0.2 FEET ABOVE ADJACENT GRADE.

NO.	REVISION	DATE	GARDNERVILLE WATER COMPANY - STANDARD DETAIL	DRAWING NO.	
1	MISC. REVISIONS	09/12	<h1 style="margin: 0;">WATER SERVICE CONNECTION</h1>	<h2 style="margin: 0;">G-5</h2>	
2	2022 UPDATES	09/22		DATE:	PAGE:
3	GWC REVISIONS	07/24		07/24	5